

<b>AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT</b>				I. CONTRACT ID CODE J	PAGE OF PAGES 1   3
2. AMENDMENT/MODIFICATION NO. 0001	3. EFFECTIVE DATE 17-Sep-2004	4. REQUISITION/PURCHASE REQ. NO. W34GM1-4225-0001	5. PROJECT NO.(If applicable) FE21139-4J		
6. ISSUED BY CODE DIRECTORATE OF CONTRACTING ACA, FORT CAMPBELL BLDG 2174 13 1/2 ST FORT CAMPBELL KY 42223-1100		7. ADMINISTERED BY (If other than item 6) CODE  <b>See Item 6</b>			
8. NAME AND ADDRESS OF CONTRACTOR (No., Street, County, State and Zip Code)				X	9A. AMENDMENT OF SOLICITATION NO. W91248-04-Q-0086
				X	9B. DATED (SEE ITEM 11) 07-Sep-2004
					10A. MOD. OF CONTRACT/ORDER NO.
					10B. DATED (SEE ITEM 13)
CODE		FACILITY CODE			
<b>11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS</b>					
<input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offer <input type="checkbox"/> is extended, <input type="checkbox"/> is not extended. Offer must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended by one of the following methods: (a) By completing Items 8 and 15, and returning _____ copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.					
12. ACCOUNTING AND APPROPRIATION DATA (If required)					
<b>13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.</b>					
A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.					
B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(B).					
C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:					
D. OTHER (Specify type of modification and authority)					
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office.					
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.) Solicitation, W91248-04-Q-0086, Replace Fire Alarm Panel in Building 6944, Fort Campbell, Kentucky is amended as follows:  <p style="text-align: center;">SEE ATTACHED SHEET</p>					
Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.					
15A. NAME AND TITLE OF SIGNER (Type or print)			16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)		
			TEL: _____ EMAIL: _____		
15B. CONTRACTOR/OFFEROR  _____ (Signature of person authorized to sign)	15C. DATE SIGNED	16B. UNITED STATES OF AMERICA  BY _____ (Signature of Contracting Officer)		16C. DATE SIGNED 17-Sep-2004	

## SECTION SF 30 BLOCK 14 CONTINUATION PAGE

**SUMMARY OF CHANGES**

Solicitation, W91248-04-Q-0086 to Replace Fire Alarm Panel in Building 6944, Fort Campbell, Kentucky is amended as follows:

a. Clarifications on specifications are as follows:

Panel zones shall be at least for the below designations:

- a. 1<sup>st</sup> floor
- b. 2<sup>nd</sup> floor
- c. 3<sup>rd</sup> floor
- d. Dining facility
- e. Kitchen hoods
- f. Basement
- g. Mechanical room
- h. Spare

Contractor shall provide a lightening surge arrester for the King Fisher antenna

Drawings have been amended to show deleted and added devices. However drawings are not to scale and Contractor shall verify correct location of devices prior to installation. (Attached)

Contractor shall provide means to disconnect the power to the Fire alarm Control Panel and King Fisher transmitter at the panels. This shall be labeled or have a sign if external to the panels. Tamper proof devices such as a key type disconnect or internal device is acceptable. (Key device shall use same key as panel. A label or sign shall be provided indicating "Fire Alarm Power" "Do not shut off".)

Fire Alarm Control Panel shall have back up battery capability of 48 hours with a 5-minute sounding time after 48 hours.

Questions about kitchen hood systems - We are only interested in connecting the signal circuit located in the Ansul panels to the alarm; there are 4 hoods

We are not looking for a class "A" system.

Some places will not be in compliance with NFPA such as the boiler room

Existing conduit in good shape may be re-used if possible. (Concurrence of the inspector is required for "good shape".)

Conduit and wire shall be installed by qualified electrical workers. (Kentucky license is not required)

Paragraph 1.3 - an "or Equal" panel shall be approved prior to installation, paragraph 1.23.

Paragraph 1.6 - wiring better than 16 gauge is acceptable as long as it is copper

Paragraph 1.11 - delete horn/strobe requirement in stairwells


Paragraph 1.13 - Qualified Technician, A NICET level 1 technician is acceptable as the technician.

Item 2.3 - Electric Permit, there is no charge for a permit.

They will still have to provide the shop drawings and verify locations and such but I think I have made them a little closer to reality.


1. Hall is approximately 244 feet.
2. Drawings are not accurate; Contractor shall verify correct location for devices prior to installation.

265.7

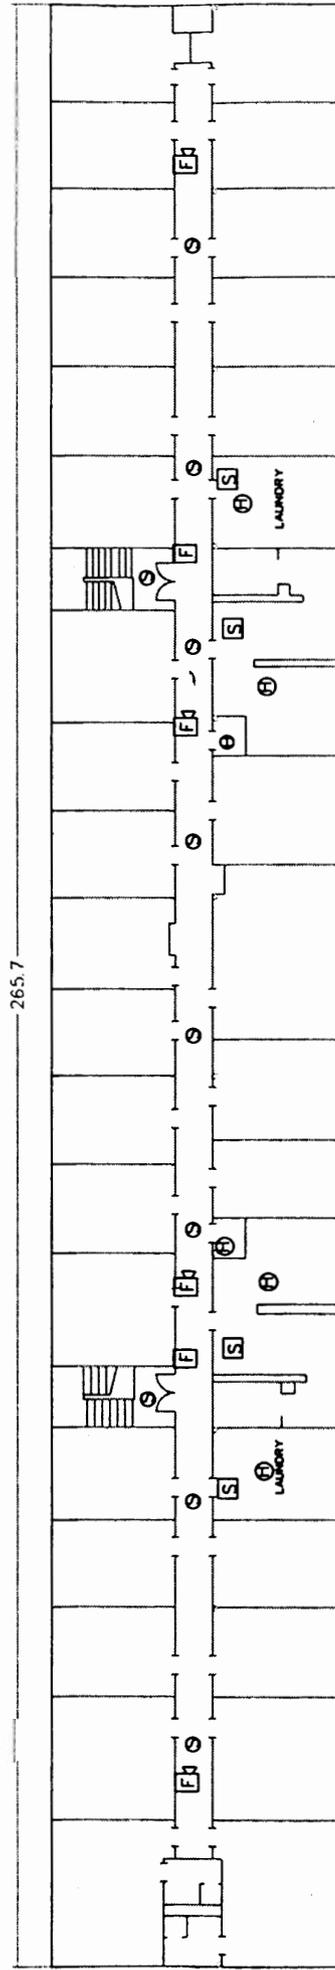

38.3

Drawing typical 2nd and 3rd floors.



KEY PLAN

FE 21139 4J



REPLACE FIRE ALARM SYSTEM  
BUILDING 6944

326TH EN/HHC

FACILITY NUMBER  
P6944-2A

September 2004

- Hall is approximately 190 feet.
- Drawings are not accurate; Contractor shall verify correct location for devices prior to installation.

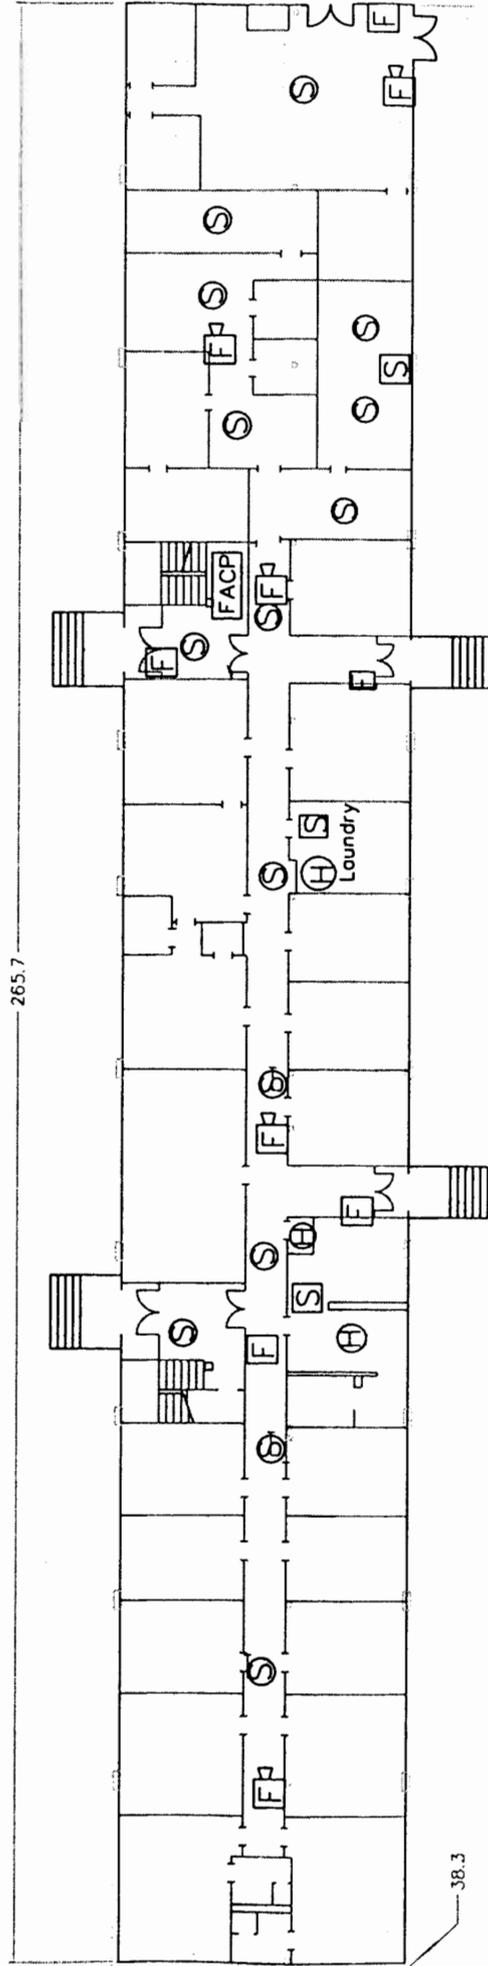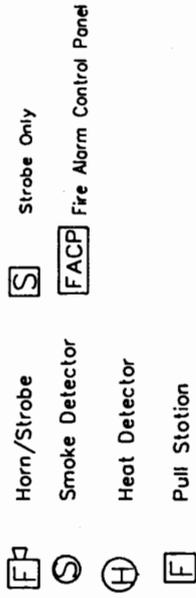

1st FLOOR

FE 21139 4J

Replace Fire Alarm System

BUILDING 6944

September 2004


FACILITY NUMBER

P6944-1A

326TH EN/HHC

1. Drawings are not accurate; Contractor shall verify correct location for devices prior to installation.

-  Horn/Strobe
-  Smoke Detector
-  Heat Detector
-  Pull Station
-  Strobe Only

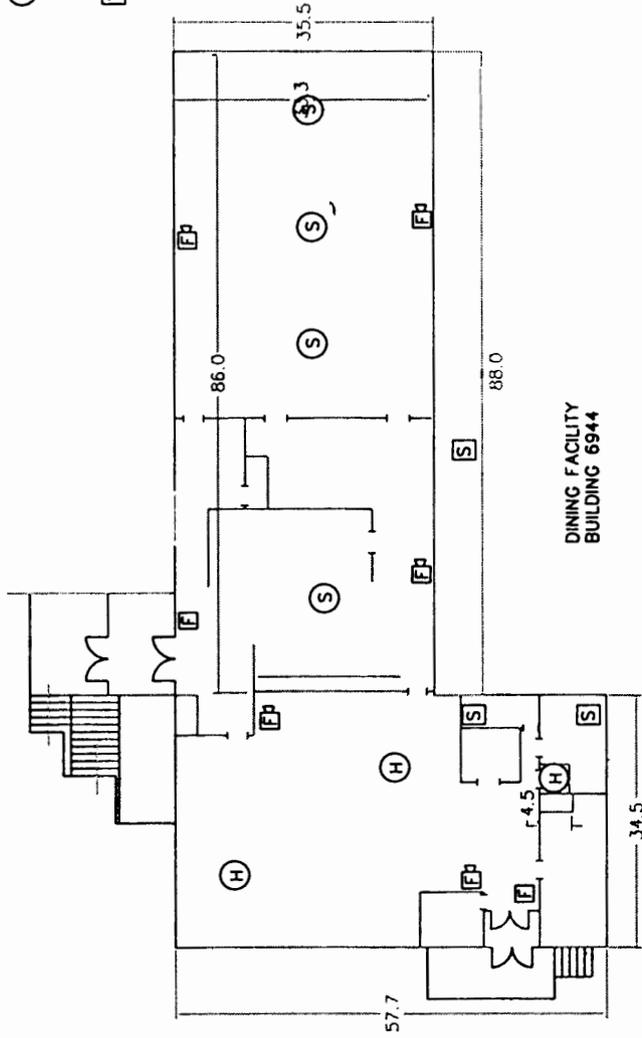

1. Drawing is intended as a guide only
2. Exterior Strobe Shall be Weatherlight

DINING FACILITY  
BUILDING 6944

KEY PLAN

326TH EN/HHC


REPLACE FIRE ALARM SYSTEM  
BUILDING 6944

September 2004

FACILITY NUMBER  
P6944-1WA

1. Drawings are not correct. Contractor shall verify correct location for devices prior to installation.

- EH Horn/Strobe
- S Smoke Detector
- H Heat Detector
- F Pull Station

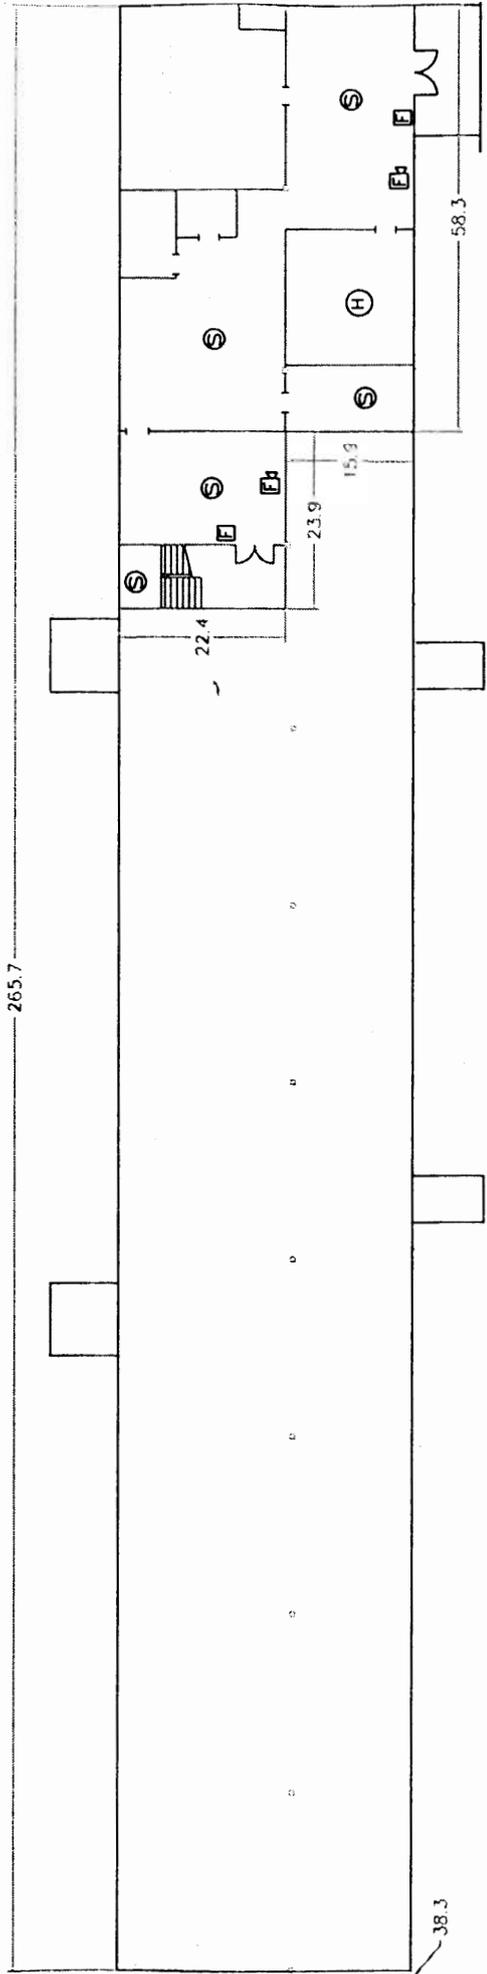

BASEMENT

326TH EN/HHC

REPLACE FIRE ALARM SYSTEM  
BUILDING 6944


FE 21139 4J

September 2004

FACILITY NUMBER

P6944-bA

-  Pull Station
-  Smoke Detector
-  Heat Detector
-  Horn/Strrobe

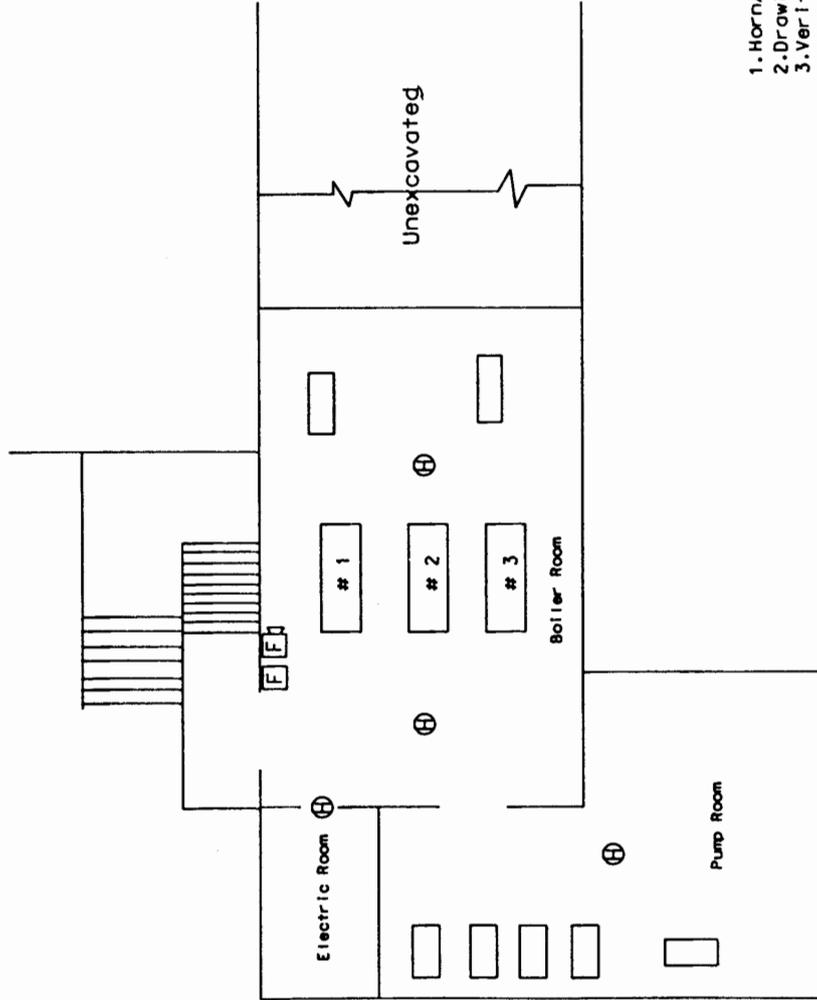

1. Horn/Strrobe and Pull Station shall be Weathertight
2. Drawing is intended for a guide only
3. Verify location of devices prior to installation.

326TH EN/HHC

REPLACE FIRE ALARM SYSTEM

FE 21193 4J

September 2004

FACILITY NUMBER

6944